LIQUID LEAK DETECTION SYSTEMS

# FG-ALS4

## Four-Zone Alarm & Location System Unit

Installation Notice

# Installation Notice FG-ALS4


## 1 Panel Mounting

- Fix the panel to the wall using 4 screws (not included).
- Five push-through holes are provided for installing the PG11 glands.
  1. Power supply
  2. Relays
  3. Outputs 1&2
  4. Outputs 3&4
  5. JBUS/MODBUS
- Knock out the push-through holes from the outside.
- Connect all plug-in terminals (refer to step 2).
- Plug the terminals.
- Close the box, starting by inserting the top side, and then push the bottom down. Lock, using the two available screws.
- Power up from the circuit breaker.

## 2 Electrical Connections

- Connect the sense cables following this color code:
  - A: Green
  - B: White
  - C: Black
  - D: Red

  Terminate unused outputs with two loops between connectors A & B and C & D.

  The wiring diagram is on the back page.
- Connect the relays:
  - COM: Common
  - NC: Normally Closed
  - NO: Normally Open
- Five relays are available on FG-ALS4:
  - Relay 1 = leak zone 1
  - Relay 2 = leak zone 2
  - Relay 3 = leak zone 3
  - Relay 4 = leak zone 4
  - Relay 5 = cable-break all zones
- Connect the power supply following the signs:
  - Ground sign: Ground
  - N: Neutral
  - L: Live

  Power supply : 100-240 V AC 50/60 Hz 0.25 A

## 3 Capacity

The FG-ALS4 panel is designed to receive up to 45m (147 ft) of sense cable (FG-ECS, FG-ACS, FG-ECX, FG-ACX) per zone.

## 4 Powering-on the System

Power on from the circuit breaker:
The panel will sound and show "SYSTEM TEST" for 20 seconds on the display, and will then show the "home" screen:


- Touch the first button (flag) to change the language:
  - English
  - French
  - German

  The language setting will affect the bottom banner and the texts in the alarm screen.
- Touch the second button (arrows) to show the lengths installed in each of the 8 zones (please refer to step 5).
- Touch the third button (gears) to change the MODBUS slave number.

## 5 Settings

- Touch the second button (arrows), the touch screen shows the lengths installed on each of the four zones:


- Touch the "home" button to return to the main page.
- Touch the "refresh" button (arrows) to update the lengths displayed.

The system will return to the "home" screen after 30 seconds of inactivity.

- Touch the third button (gears) to change the Modbus slave number.

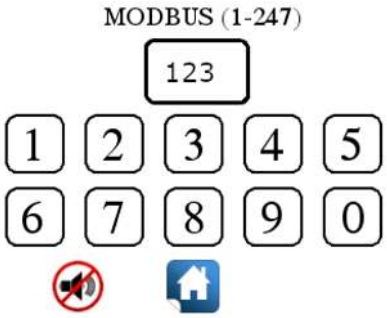


- Alarm screen:

If a fault occurs (leak or cable-break), the leak alarms are represented by a drop of liquid;

Cable-break alarms are represented by scissors and the "sensor" label.


The system will return to the "home" screen after 30 seconds of inactivity.

## 6 MODBUS

The MODBUS protocol implemented on FG-ALS4 allows the current status of the system to be supervised. The two types of alarm (leak and cable-break) are coded using different Modbus registers for each individual zone.

The physical support of the MODBUS is two-wire RS485.

| | |
|---|---|
| Serial port configuration | 9600 B, 8 data bits, 1 stop bit, no parity |
| Communication protocol | MODBUS or JBUS, functions 3 or 4 |
| Maximum number of FG-ALS connected to the same controller | 31 |
| Slave number | 1 to 255 |
| Maximum number of reading registers | 16 |
| MODBUS addresses in the memory | Register 1 = length zone 1<br>Register 2 = leak zone 1<br>Register 3 = cable-break zone 1<br>Register 4 = leak location zone 1<br><br>Register 5 = length zone 2<br>Register 6 = leak zone 2<br>Register 7 = cable-break zone 2<br>Register 8 = leak location zone 2<br><br>Register 9 = length zone 3<br>Register 10 = leak zone 3<br>Register 11 = cable-break zone 3<br>Register 12 = leak location zone 3<br><br>Register 13 = length zone 4<br>Register 14 = leak zone 4<br>Register 15 = cable-break zone 4<br>Register 16 = leak location zone 4 |

Format of the solution:

| Slave number | Function | No. of bytes read | Byte 1 | Byte 2 | ... | Byte N | CRC 16 |
|---|---|---|---|---|---|---|---|
| 1, 2, ..., 255 | 3 or 4 | up to 32 | XXh | XXh | ... | XXh | XXXXh |

- Remarks:

- The last panel on the serial link should be terminated with a 120 Ohms / 1W resistor between points RT- and RT+. The shielding of the data transmission cable should be connected to the controller's earth and to the terminal COM of each FG-ALS panel.
- Slave number 0 inhibits the MODBUS operation.
- It is advisable to leave at least 200 ms between the successive requests.

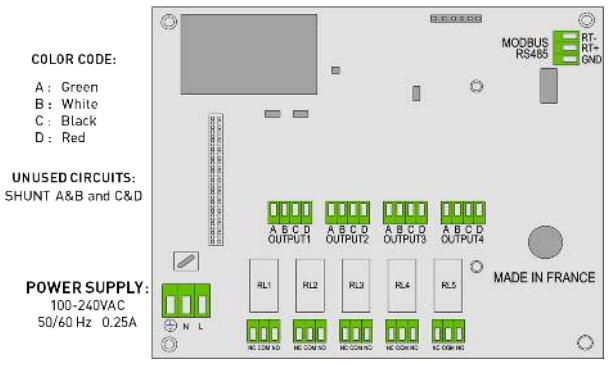


**FG-ALS4 wiring diagram**

FG-ALS4 Installation Notice EN_v1.0.8_062021



- **TTK Headquarters** / 19 Rue du Général Foy, 75008 Paris, France / T: +33.1.56.76.90.10 / F: +33.1.55.90.62.15 / **www.ttk.fr** / **ventes@ttk.fr**
- **TTK UK Ltd.** / 3 Luke Street London EC2A 4PX / United Kingdom / T : +44 20 7729 6002 / F : +44 20 7729 6003 / **www.ttkuk.com** / **sales@ttkuk.com**
- **TTK Pte Ltd.** / #10-08, Shenton House, 3 Shenton Way / Singapore 068805 / T: +65 6220.2068 / M: +65 9271.6191 / F: +65 6220.2026 / **www.ttk.sg** / **sales@ttk.sg**
- **TTK Asia Ltd.** / 2107-2108 Kai Tak Commercial Building / 317 Des Voeux Road Central / Hong Kong / T: +852 2858.7128 / F: +852 2858.8428 / **www.ttkasia.com** / **info@ttkasia.com**
- **TTK Middle East FZCO** / Building 6EA, Office 510 PO Box 54925 / Dubai Airport Free Zone / UAE / T: +971 4 70 17 553 / M: +971 50 259 66 29 / **www.ttkuk.com** / **cgalmiche@ttk.fr**
- **TTK Deutschland GmbH** / Berner Strasse 34, 60437 Frankfurt / Germany / T : +49 (0)69-95005630 / F : +49(0)69-95005640 / **www.ttk-gmbh.de** / **vertrieb@ttk-gmbh.de**
- **TTK North America Inc** / 1730 St Laurent Boulevard Suite 800 / Ottawa, ON, K1G 5L1 / Canada / T: +1 613 566 5968 / **www.ttkcanada.com** / **info@ttkcanada.com**
- **Thomas Sales & Marketing Inc. TTK Master Distributor For USA** / 7200 W 66th St / Bedford Park, IL 60638 / USA / T: +1 630-518-4724 / **www.ttkusa.com** / **dmolk@ttkusa.com**